

Standard ISO 14644-1

Sampler ID: 132214

Test Start: 23.09.2022

Report Date: 03.01.2023

Test End: 24.11.2022


Exposure: 62 days, 0 hours, 0 minutes

SCOPE:

This report corresponds to ISO 14644-1 which is a widely accepted standard for qualifying indoor air cleanliness in terms of the concentration of airborne particles per cubic meter.

TEST RESULT:

21.39% of the ISO 14644-1 Class 8 limit

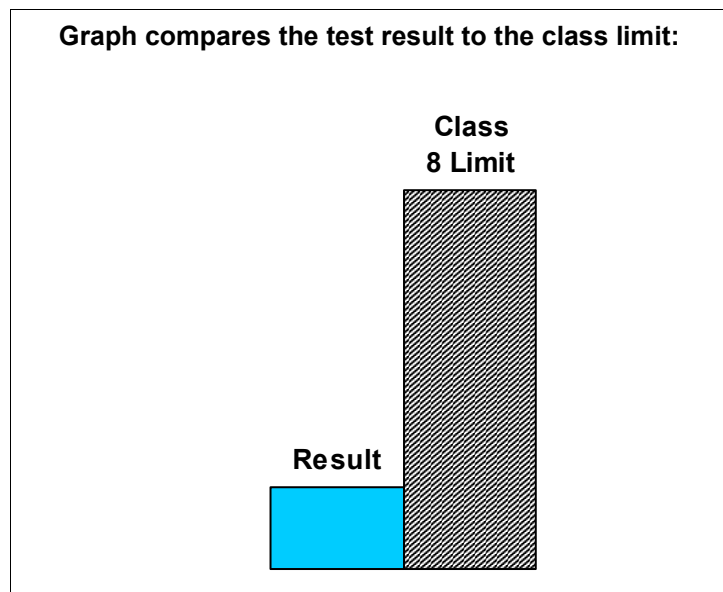

Recommendations:

ISO 14644-1 Class 9: General indoor rooms.

ISO 14644-1 Class 8: Data centers, mission critical facilities, technology spaces and electronic equipment.

ISO 14644-1 Class 7: Biopharma products, sterile pharmaceuticals, electronics components, medical devices and implants; and the maintenance of sensitive aviation and avionics systems.